



TECHNICAL DATA

FROM

Anemostat

Door Products

4958 Stout Dr. #119, San Antonio, TX 78219
 PH: 210.662.6300 • FAX: 210.662.2828
 e-mail: door@anemostat.com • website: www.anemostat.com

SAFE-Wire®

1/4" (6mm)

WITH SURFACE APPLIED FILM
 (Fire & Impact/Safety Rated)



FIRE RATED BY
 UNDERWRITERS'
 LABORATORIES




CATEGORY II IMPACT/SAFETY RATED
 ANSI Z97.1 2004 U A

DETAIL DRAWING

FIRE & SAFETY RATED

MEETS CURRENT IBC CODE REQUIREMENTS

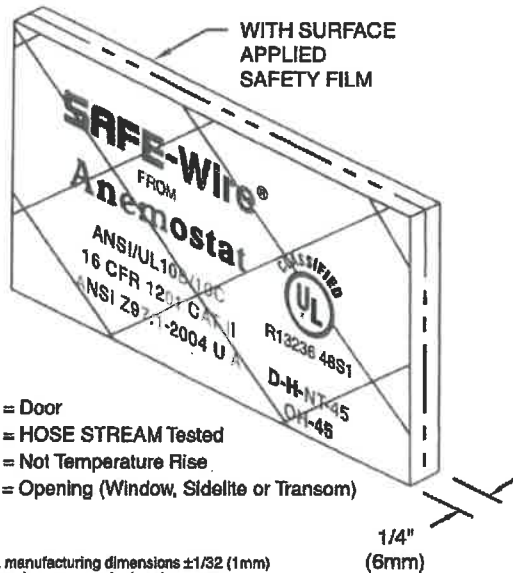


- D = Door
- H = HOSE STREAM Tested
- NT = Not Temperature Rise
- OH = Opening (Window, Sidelite or Transom)

Anemostat manufacturing dimensions ±1/32 (1mm)
 Actual dimensions are nominal and may vary based on component manufacturers tolerances.



3/4" (19mm)
 Diamond
 Pattern

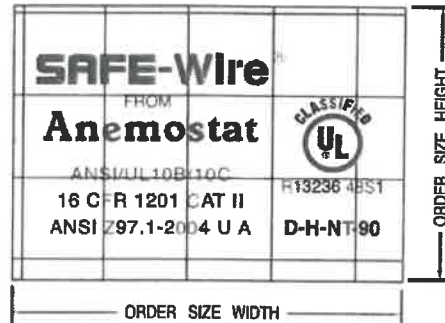

1/2" (13mm)
 Square
 (Georgian)
 Pattern

STANDARD PRODUCT FEATURES

- **MATERIAL:** 1/4" (6mm) Polished wire glass with surface applied safety film.
- **FINISH:** Clear with 3/4" x 3/4" (19mm x 19mm) diamond, or 1/2" x 1/2" (13mm x 13mm) square wire pattern.
- **INSTALLATION:** SAFE-Wire shall be glazed into the appropriate fire rated framing with GT-18, 1/8" (3.2mm) fire rated glazing tape (supplied loose), to both sides of glass.
- **CLASSIFICATION MARKINGS:** Each piece of cut to size 1/4" (6mm) SAFE-Wire glass is permanently etched with the listing mark of U.L., in accordance with standards set forth by N.F.P.A - 80 revised.
- **USES:** SAFE-Wire glass is a fire and impact/safety rated glazing material, composed of polished wire glass and a special clear surface applied safety film. It carries a listing for use in INTERIOR Doors, Sidelites, Transoms and Borrowed Lites with fire ratings from 20 minutes to 90 minutes.
- **NOTE:** Film is applied to one side of SAFE-Wire only. However, Fire Rating is not dependent on which way film faces in interior applications.
- Occasional process marks or small occlusions may occur due to the filming method employed in manufacturing this product. However, this does not affect the fire/safety performance or general vision area of the glazing and should not be a cause for rejection. Please refer to our Quality Specifications & Inspection Guidelines for Filmed Glazing for additional information (page 3).
- **IMPORTANT:** Interpretation of building and fire codes may vary. Consult with the local authority having jurisdiction in your area, to determine appropriate standards.

OPTIONAL FEATURES

- **SIZES:** Customized glass sizes to fit most any shape vision frame.

FIRE RATINGS (w/ U.L. classification marking) Positive Pressure

- **20 MINUTE:** Approved listing at 2994 sq.in. (1.932 m²) visible lite.
- **45 MINUTE:** Approved listing at 1296 sq.in. (0.836 m²) visible lite.
- **60/90 MINUTE:** Approved listing at 100 sq.in. (0.065 m²) visible lite.
- **NOTE:** Labeled sizes over 1296 sq.in. (0.836 m²) are available providing installation application is appropriately fire rated.

IMPACT / SAFETY RATINGS

- Meets ANSI Z97.1-2004 U A and CPSC 16CFR-1201.
 - Category I - up to 9 sq. ft. (0.837 m²)
 - Category II - over 9 sq. ft. (0.837 m²)

SOUND RATINGS with LoPro-STC

- **LoPro-STC with SAFE-Wire:** STC - 38
- **TESTED SIZE:** 24" X 36" (610mm x 914mm) CUTOUT / ASSEMBLY
- **TESTED IN ACCORDANCE WITH:** ASTM E90-09 and ASTM E2235-04. STC measurements determined in accordance with ASTM E413-04. Testing conducted at Western Electro - Acoustic Laboratory, Santa Clarita, CA.
- **Fire Rated**

Job Name & Location	Submitted by
---------------------	--------------

For Most Current Info, Consult Factory or check our website, www.anemostat.com

Welcome to the SAFTIFIRST™ Guide Specification System prepared as an aid to specifiers in preparing written construction documents. For specification assistance with specific product applications, please contact SAFTIFIRST™. To download an electronic copy, please visit www.safti.com.

SPECIFICATION
SECTION 08 8810: FIRE RATED GLASS & FRAMING
SuperLite™ I-W 20-90 minute

PART 1 GENERAL

1.01 SUMMARY

- A. Section Includes: Fire rated glazing**
1. SuperLite™ I-W patented, fire protective, safety rated, wired glazing material for interior and exterior applications.
 2. Applications of fire rated glazing include:
 - a. Fire rated glazing as vision lites in door assemblies.
 - b. Fire rated glazing as sidelites, windows or transoms in fire rated frames.
- B. Related Sections:**
1. Section 01 3323: Shop Drawings, Product Data and Samples.
 2. Section 06 4000: Architectural Woodwork.
 3. Section 08 1110: Steel Doors and Frames.
 4. Section 08 1120: Aluminum Doors and Frames.
 5. Section 08 1113: Hollow Metal Doors and Frames.
 6. Section 08 1400: Wood Doors and Frames.
 7. Section 08 5130: Steel Windows.
 8. Section 08 7000: Finish Hardware.
 9. Section 08 8000: Glazing.

1.02 REFERENCES

- A. American Society for Testing and Materials (ASTM):**
1. ASTM E152: Methods of Fire Tests of Door Assemblies.
 2. ASTM E163: Methods of Fire Tests of Window Assemblies.
 3. ASTM E2074-00: Methods of Fire Tests of Door Assemblies, including Positive Pressure Testing of Side-hinged and Pivoted Swinging Door Assemblies.
 4. ASTM E2010-01: Standard Test for Positive Pressure of Fire Tests of Window Assemblies.
- B. National Fire Protection Association (NFPA):**
1. NFPA 80: Fire Doors and Windows.
 2. NFPA 252: Fire Tests of Door Assemblies.
 3. NFPA 257: Fire Tests of Window Assemblies.
- C. Underwriters Laboratories, Inc. (UL):**
1. UL 9: Standard for Safety of Fire Tests of Window Assemblies.
 2. UL 10 B: Standard for Safety of Fire Tests of Door Assemblies.
 3. UL 10 C: Standard for Safety of Positive Pressure Tests of Door Assemblies.
- D. Standard Council of Canada (ULC):**

1. ULC Standard CAN4-S104: Fire Tests of Door Assemblies.
 2. ULC Standard CAN4-S106: Fire Tests of Window Assemblies.
 3. CSN/ULC-S101M: Standard Methods of Fire Endurance Tests.
- E. Consumer Product Safety Commission (CPSC):
1. CPSC 16 CFR 1201: Safety Standard for Architectural Glazing Materials.
- F. Glass Association of North America (GANA)
1. GANA – Glazing Manual.
 2. FGMA – Sealant Manual.
- G. [American Recovery and Reinvestment Act
1. Section 1605, Title XVI Buy American Provision]
- H. [Insert building code used by Authority Having Jurisdiction]

1.03 SYSTEM DESCRIPTION

- A. Performance Requirements: Provide a fire rating glazing manufactured, fabricated and installed to maintain performance criteria stated by manufacturer without defects, damage or failure.
1. Fire Rating: 20-90 minutes with hose stream.
 2. Fire protective, safety rated, wired glass tested in accordance with NFPA 80, NFPA 252, NFPA 257, UL 9, UL 10B and UL 10C.
 3. Testing Laboratory: Fire test shall be conducted by a nationally recognized independent testing laboratory.
- B. Listings and Labels:
1. Fire rated glazing shall be under current follow-up service by a nationally recognized independent testing laboratory approved by OSHA and maintain a current listing or certification. Assemblies shall be labeled in accordance with limits of listings.

1.04 SUBMITTALS

- A. Submit listed submittals in accordance with Conditions of the Contract and Division 1 Submittal Procedure Section.
1. Shop Drawings: Submit shop drawings showing layout, profiles and product components.
 2. Samples: Submit 6x6 glass samples.
 3. Technical Information: Submit latest edition of manufacturer's product data.

1.05 DELIVERY, STORAGE AND HANDLING

- A. General: Comply with Division 1 Product Requirements Sections.
- B. Ordering: Comply with manufacturer's ordering instructions and lead-time requirements to avoid construction delays.

- C. **Delivery:** Deliver materials to specified destinations in manufacturer's or distributor's packaging undamaged, complete with installation instructions.
- D. **Storage and Protection:** Store off ground, under cover, protected from weather and construction activities and at temperature conditions recommended by manufacturer.

1.06 PROJECT CONDITIONS

- A. **Field Measurements:** Verify actual measurements for openings by field measurements before fabrication. Show recorded measurements on shop drawings. Coordinate field measurements and fabrication schedule with construction progress to avoid construction delays.

1.07 WARRANTY

- A. **Project Warranty:** Refer to Conditions of the Contract for project warranty provisions.
- B. **Manufacturer's Warranty:** Submit, for Owner's acceptance, manufacturer's standard warranty document. Manufacturer's warranty is not intended to limit other rights that the Owner may have under the Contract Documents.
 - 1. **Warranty Period:** 10 years from date of shipping.

PART 2 PRODUCTS

2.01 FIRE RATED GLAZING

- A. **Material:** SuperLite I-W 20-90 minute fire and safety rated wired glass.
 - 1. Patented product, no known equal.
- B. **Manufacturer:** SuperLite I-W as manufactured and distributed by SAFTIFIRST.
 - 1. **Contact:** 100 N Hill Drive, Suite 12, Brisbane, CA 94005; Telephone 888.653.3333; Fax 888.653.4444; email info@safte.com; Web site www.safte.com
 - 2. Fire rated glass and framing must be provided by a single-source, US manufacturer. Distributors of fire rated glass and framing are not to be considered as manufacturers.
- C. **Design Requirements:**
 - 1. **Thickness:** Must have a nominal thickness of 5/16" (8mm).
 - 2. **Weight:** Must weigh 3 lbs./sq. ft.
 - 3. **Appearance:** Must be filmed (7mil) wired glass free of noticeable irregularities.
 - 4. **Fire Rating:** Must be fire rated from 20-90 minutes with hose stream.
 - 5. **Impact Safety Resistance:** Must meet CPSC 16 CFR 1201 Cat. I & II.
- D. **Manufacturer's Fire Rated Glazing Material:**
 - 1. Each piece of fire-rated glazing material shall be labeled with a permanent logo including name of product, manufacturer, testing laboratory, fire rating period and safety glazing standards.
 - 2. Glazing material installed in Hazardous Locations, subject to human impact, shall be certified and permanently labeled as meeting applicable requirements referenced in NFPA 80:

- a. CPSC 16 CFR 1201, Cat. I & II

E. Substitutions: No substitutions allowed.

2.02 MATERIALS

- A. Glazing Accessories: Manufacturer recommended fire rated glazing accessory as follows:
 - 1. Glazing techniques include listed fire rated closed-cell foam tape, listed fire rated ceramic glazing tape, 100% silicone caulking and Pemko FG3000 Fire Glaze.

2.03 RELATED PRODUCTS

Note: Basis of design for fire rated framing system is SAFTI*fire*TM Framing as manufactured by SAFTI *FIRST*TM

- A. Glazing shall be installed in an equally rated framing system.

2.04 SOURCE QUALITY

- A. Obtain fire rated glazing products from a single manufacturer.
- B. Fabrication Dimensions: Fabricate to approved dimensions. The general contractor shall guarantee dimensions where practicable within required tolerances.

PART 3 EXECUTION

3.01 EXAMINATION

3.01 MANUFACTURER'S INSTRUCTIONS

- A. Compliance: Comply with manufacturer's product data including product technical bulletins and installation instructions.

3.02 EXAMINATION

- A. Site Verification of Conditions: Verify substrate conditions, have been previously installed under other sections, and are acceptable for product installation in accordance with manufacturer's instructions.

3.03 INSTALLATION

- A. Installation shall be in strict accordance with the fire glazing material manufacturer's specifications. Field cutting or tampering is strictly prohibited.

3.04 CLEANING AND PROTECTION

- A. Protect glass from contact with contaminating substances resulting from construction operations. Remove such substances by method approved by manufacturer.
- B. Wash glass on both faces not more than four days prior to date schedule for inspections

intended to establish date of Substantial Completion. Wash glass by method recommended by glass manufacturer.

- C. Remove temporary coverings and protection of adjacent work areas.
- D. Remove construction debris from project site and legally dispose of debris.

END OF SECTION

In the interest of continuous improvement of its product line, SAFTIFIRST™ reserves the right to modify its products' composition, colors, textures, sizes, and other physical and performance attributes and these guide specifications at any time. SAFTIFIRST™ makes no expressed or implied warranties regarding content, errors, or omissions in the information presented. Specifications modified or rewritten not in conformance with manufacturer's standard processes, products, and procedures may void warranties and related remedies.